



BRONZE NEEDLE VALVE PN25

Model/Ref: 482



*Partnership.
Without Limits.*

www.lauridsenindustri.com

BRONZE NEEDLE VALVE PN25




Size : DN 1/4" to 3/4"
Ends : Female - Female BSP
Min Temperature : - 10°C
Max Temperature : + 180°C
Max Pressure : 25 Bars
Specifications : Rising rotating stem and handwheel
PTFE packing
Brass bonnet and needle

Materials : Bronze body


BRONZE NEEDLE VALVE PN25

HEAD LOSS GRAPH :

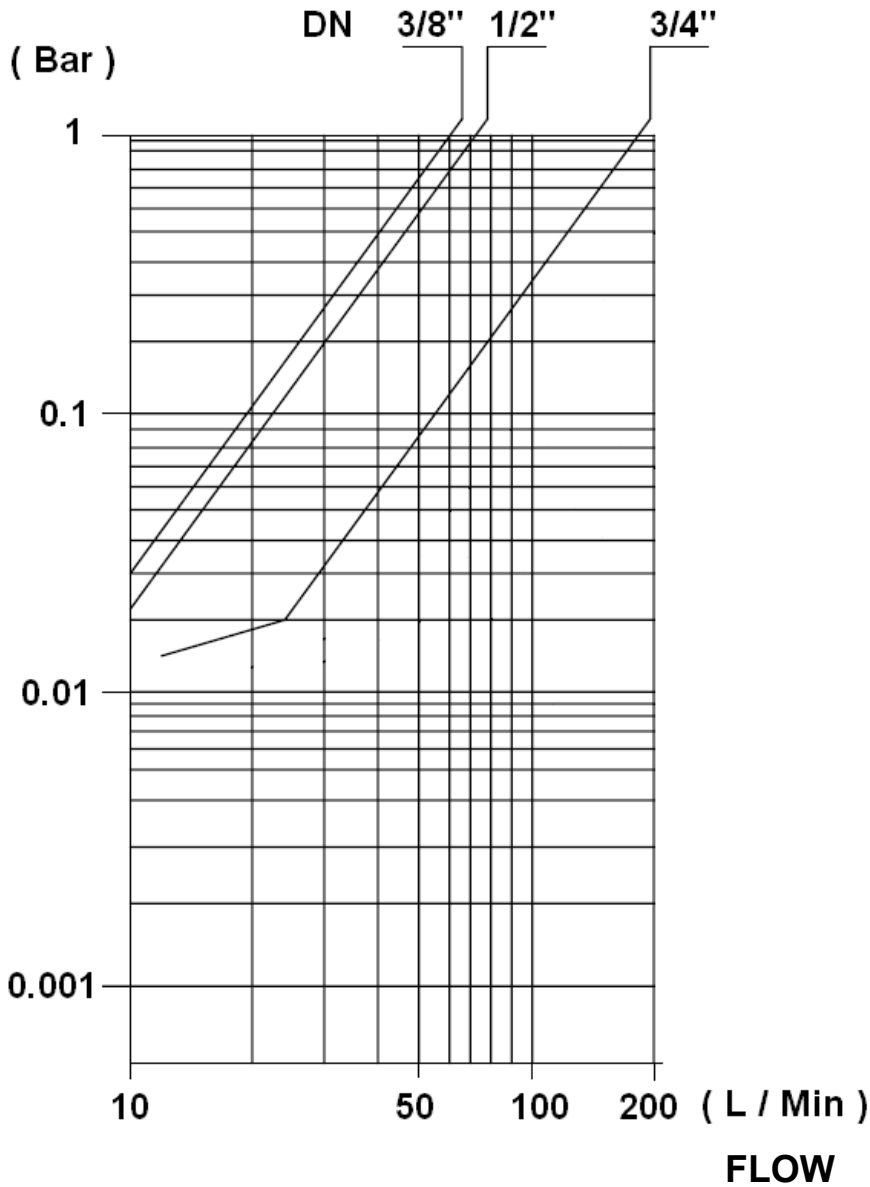

RANGE :


- Bronze body and brass needle, threaded female cylindrical BSP from DN 1/4" to DN 3/4" Ref. 482

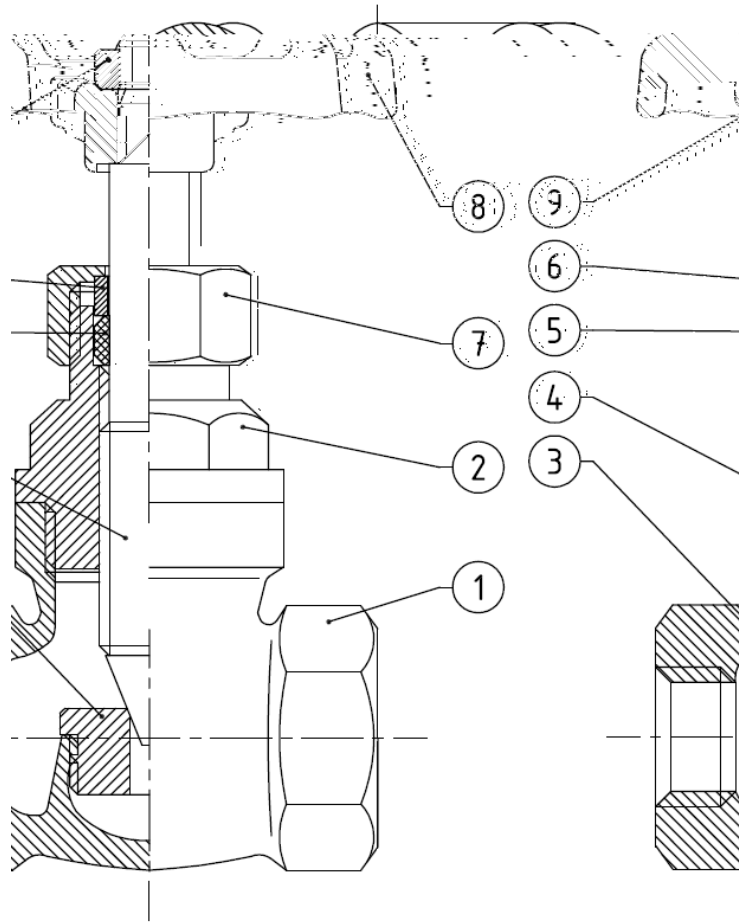BRONZE NEEDLE VALVE PN25
MATERIALS :


Item	Designation	Materials 482
1	Body	Bronze CC491K UNI EN1982
2	Bonnet	Brass CW 614N according to EN 12164
3	Seat	Brass CW 614N according to EN 12164
4	Stem	Brass CW 614N according to EN 12164
5	Packing	PTFE
6	Packing gland	Brass CW 614N according to EN 12164
7	Packing nut	Brass CW 614N according to EN 12164
8	Handwheel	Aluminium GD12FE UNI EN1706
9	Handwheel nut	Steel 6S UNI 5589

BRONZE NEEDLE VALVE PN25

SIZE (in mm) :

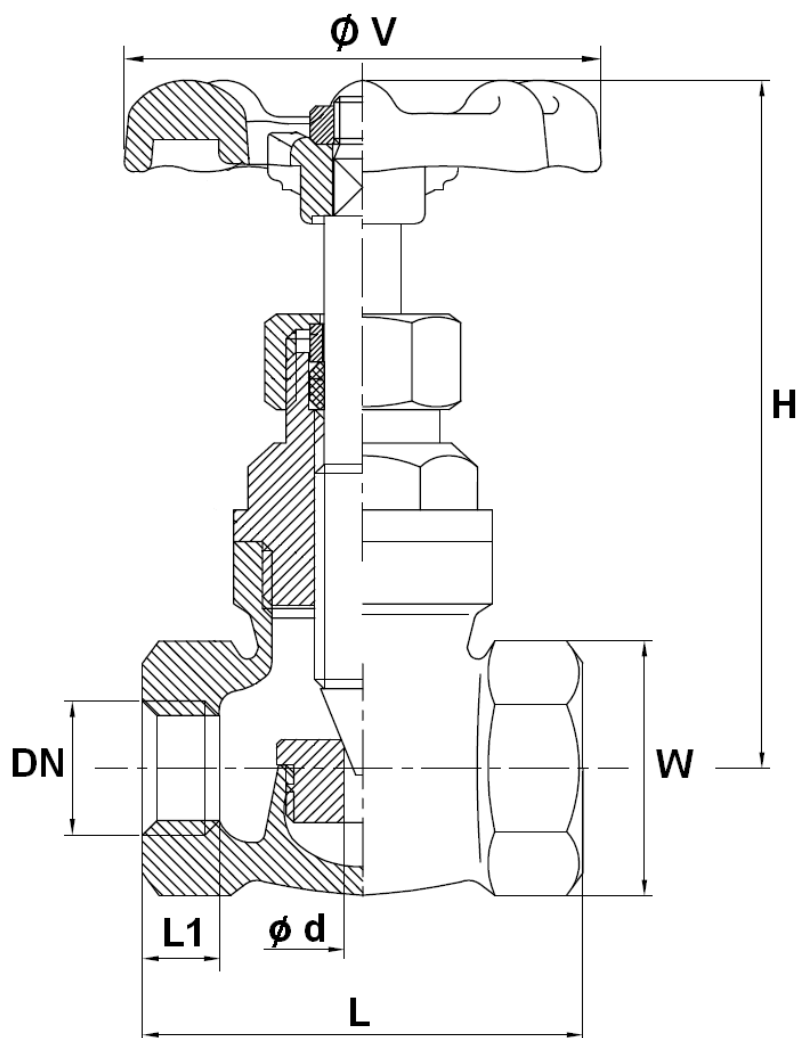

Ref.	DN	1/4"	3/8"	1/2"	3/4"
482	Ø d	4	5	6	8
	L	46	46	55	62
	L1	7	8	10	10
	H (closed)	73	73	80	110
	H (opened)	80	80	85	115
	Ø V	50	50	55	60
	W (on flat)	23	23	27	35
	Weight (Kg)	0.251	0.236	0.328	0.552

BRONZE NEEDLE VALVE PN25**STANDARDS :**

- Fabrication according to ISO 9001 : 2008
- DIRECTIVE 97/23/CE : Concerned by article 3, § 3
- Threaded female BSP cylindrical according to ISO 228-1

ADVICE :Our opinion and our advice are not guaranteed and Lauridsen Industri shall not be liable for the consequences of damages.

The customer must check the right choice of the products with the real service conditions.

BRONZE NEEDLE VALVE PN25**INSTALLATION INSTRUCTIONS****GENERAL GUIDELINES :**

- Ensure that the valves to be used are appropriate for the conditions of the installation (type of fluid, pressure and temperature).
- Be sure to have enough valves to be able to isolate the sections of piping as well as the appropriate equipment for maintenance and repair.
- Ensure that the valves to be installed are of correct strength to be able to support the capacity of their usage.
- **Installation of all circuits should ensure that their function can be automatically tested on a regular basis (at least two times a year).**

INSTALLATION INSTRUCTIONS :

- **Before installing the valves, clean and remove any objects from the pipes** (in particular bits of sealing and metal) which could obstruct and block the valves.
- **Ensure that both connecting pipes either side of the valve (upstream and downstream) are aligned (if they're not, the valves may not work correctly).**
- **Make sure that the two sections of the pipe (upstream and downstream) match, the valve unit will not absorb any gaps. Any distortions in the pipes may affect the tightness of the connection, the working of the valve and can even cause a rupture.** To be sure, place the kit in position to ensure the assembling will work.
- The theoretical lengths given by ISO/R7 for the tapping are typically longer than required, the length of the thread should be limited, and **check that the end of the tube does not press right up to the head of the thread.**
- **Never use a vice to tighten the fixings of the valve.**
- **If sections of piping do not have their final support in place, they should be temporarily fixed. This is to avoid unnecessary strain on the valve.**
- **It may be necessary to screw the packing gland during using according to the type of use.**
- **Do not use a tool to shut the valve**
- **Fluids in the valve must not contain solid objects (it could damaged the seat).**
- It's recommended to operate the valve (open and close) 1 to 2 times per year